

BRE Test Report

Trickle Ventilator tests according to EN13141-1 2019

Prepared for: Andrew Harrison

Date: 30th October 2023

Report Number: P126537-Draft

BRE
Watford, Herts
WD25 9XX

Customer Services 0333 321 8811

From outside the UK:
T + 44 (0) 1923 664000
F + 44 (0) 1923 664010
E enquiries@bre.co.uk
www.bre.co.uk

Prepared for:
Andrew Harrison
Mighton Products Ltd.
Hinxton
Cambridgeshire
CB10 1RG



Prepared by

Name C Manescu

Position Senior Engineer

Date 30th October 2023

Signature

Authorised by

Name M Swainson

Position Principal Engineer

Date 30th October 2023

Signature

This report is made on behalf of Building Research Establishment Ltd (BRE) and may only be distributed in its entirety, without amendment, and with attribution to BRE to the extent permitted by the terms and conditions of the contract. Test results relate only to the specimens as received and tested. BRE has no responsibility for the design, materials, workmanship or performance of the product or specimens tested. This report does not constitute an approval, certification or endorsement of the product tested and no such claims should be made on websites, marketing materials, etc. Any reference to the results contained in this report should be accompanied by a copy of the full report, or a link to a copy of the full report.

BRE's liability in respect of this report and reliance thereupon shall be as per the terms and conditions of contract with the client and BRE shall have no liability to third parties to the extent permitted in law.



Table 9 – Product D

Flow rate/pressure characteristics for both flow directions and corresponding calculates EqA.

Pressure difference Δp (Pa)	qv (l.s ⁻¹) Inside to outside	CEN calculated equivalent area mm ²	Pressure difference Δp (Pa)	qv (l.s ⁻¹) outside to inside	CEN calculated equivalent area mm ²
1	1.3	1617	1	1.2	1540
2	1.8	1630	2	1.7	1538
4	2.6	1643	4	2.4	1536
8	3.7	1656	8	3.4	1534
10	4.1	1661	10	3.8	1534
20	5.9	1675	20	5.4	1532

- The calculated mean equivalent area at 1 Pa is 1578.3 mm².
- **The calculated minimum equivalent area at 1 Pa is 1539.9 mm².**

Table 10 – Product D airtightness when closed

Test Number	Differential Pressure (Pa)	Flow rate (l/s)
1	40.4	0.23

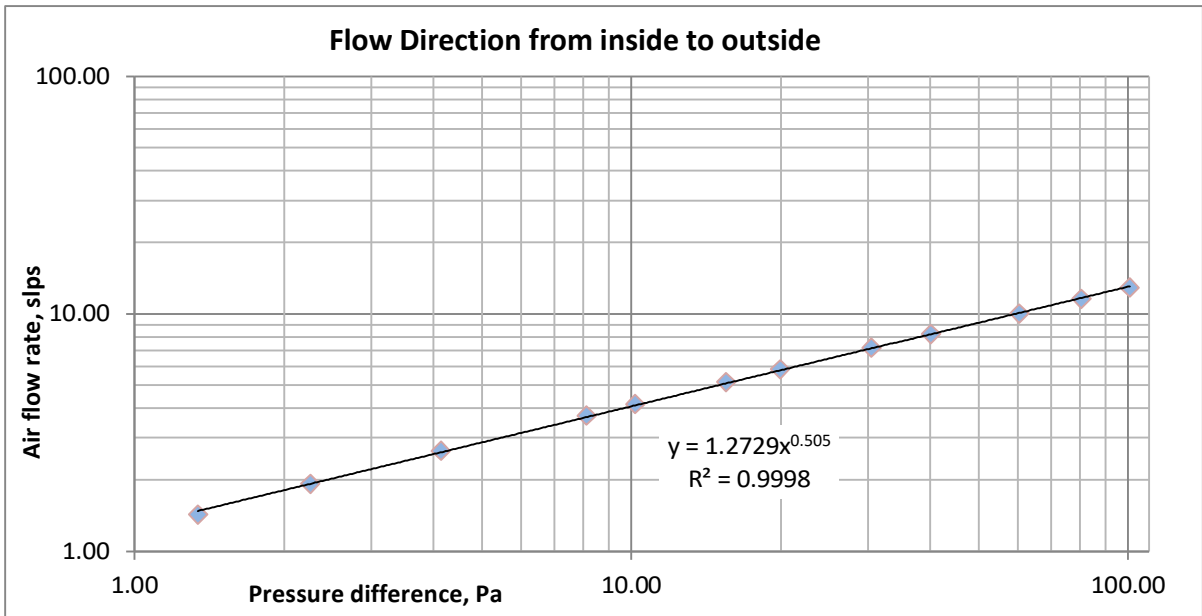


Figure 10 Measured air flow and pressure data for air flow from inside to outside

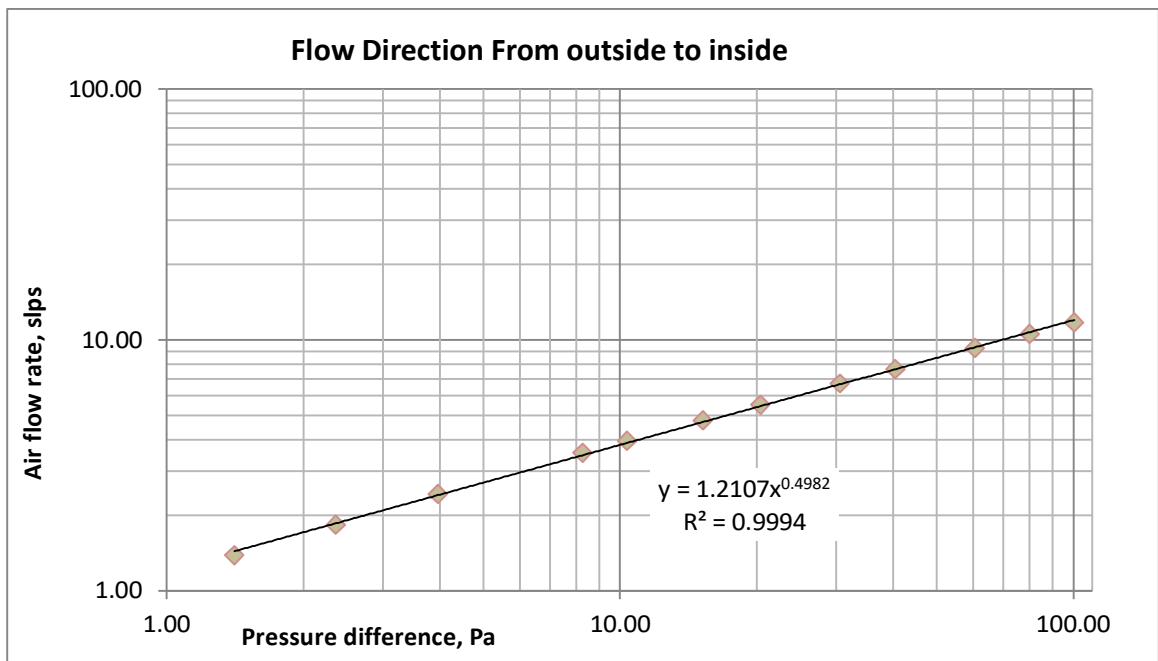


Figure 11 Measured air flow and pressure data for air flow from outside to inside